



Aalborg Universitet

AALBORG UNIVERSITY
DENMARK

Indoor Climate of Large Glazed Spaces

Hendriksen, Ole Juhl; Madsen, Christina E.; Heiselberg, Per; Svidt, Kjeld

Publication date:
1996

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):

Hendriksen, O. J., Madsen, C. E., Heiselberg, P., & Svidt, K. (1996). *Indoor Climate of Large Glazed Spaces*. Dept. of Building Technology and Structural Engineering. Indoor Environmental Technology Vol. R9655 No. 63

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.


- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -

Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

INSTITUTTET FOR BYGNINGSTEKNIK

DEPT. OF BUILDING TECHNOLOGY AND STRUCTURAL ENGINEERING
AALBORG UNIVERSITET • AAU • AALBORG • DANMARK

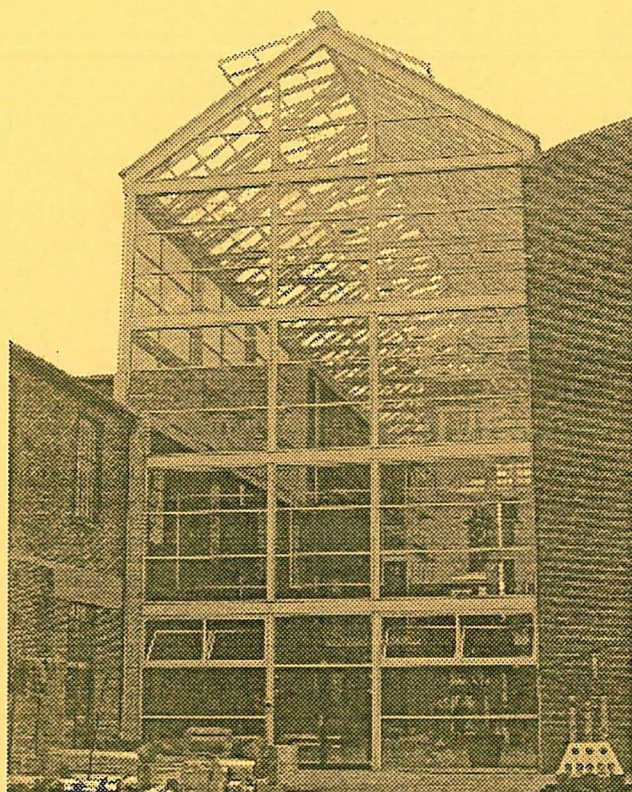

INDOOR ENVIRONMENTAL TECHNOLOGY PAPER NO. 63

Presented at the 4th European Conference on Solar Energy in Architecture
and Urban Planning, Berlin, Germany, March 1996

O. J. HENDRIKSEN, C. E. MADSEN, P. HEISELBERG & K. SVIDT
INDOOR CLIMATE OF LARGE GLAZED SPACES
DECEMBER 1996

ISSN 1395-7953 R9655

The papers on INDOOR ENVIRONMENTAL TECHNOLOGY are issued for early dissemination of research results from the Indoor Environmental Technology Group at the University of Aalborg. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible reference should be given to the final publications (proceedings, journals, etc.) and not to the paper in this series.

INDOOR ENVIRONMENTAL TECHNOLOGY
PAPER NO. 63

Presented at the 4th European Conference on Solar Energy in Architecture
and Urban Planning, Berlin, Germany, March 1996

O. J. HENDRIKSEN, C. E. MADSEN, P. HEISELBERG & K. SVIDT
INDOOR CLIMATE OF LARGE GLAZED SPACES
DECEMBER 1996

ISSN 1395-7953 R9655

INDOOR CLIMATE OF LARGE GLAZED SPACES

Ole Juhl Hendriksen and Christina E. Madsen
Esbensen Consulting Engineers FIDIC
Teknikerbyen 38
DK - 2830 Virum

Per Heiselberg and Kjeld Svidt
Aalborg University
Sohngaardsholmsvej 57
DK - 9000 Aalborg

ABSTRACT: In recent years large glazed spaces has found increased use both in connection with renovation of buildings and as part of new buildings. One of the objectives is to add an architectural element, which combines indoor- and outdoor climate. In order to obtain a satisfying indoor climate it is crucial at the design stage to be able to predict the performance regarding thermal comfort and energy consumption. This paper focus on the practical implementation of Computational Fluid Dynamics (CFD) and the relation to other simulation tools regarding indoor climate.


KEYWORDS: Natural ventilation, Computer simulation models, Atrium, Daylight evaluation, Thermal comfort

Project description

One of the important issues in design of large glazed spaces is determination of the air movements in the room and especially in the occupied zone.

This project is carried out as a case study, and comprises a monitoring programme and simulations using CFD for a natural ventilated atrium.

Furthermore the daylight conditions and the energy consumption for heating, ventilation and lighting will be analyzed in the project.

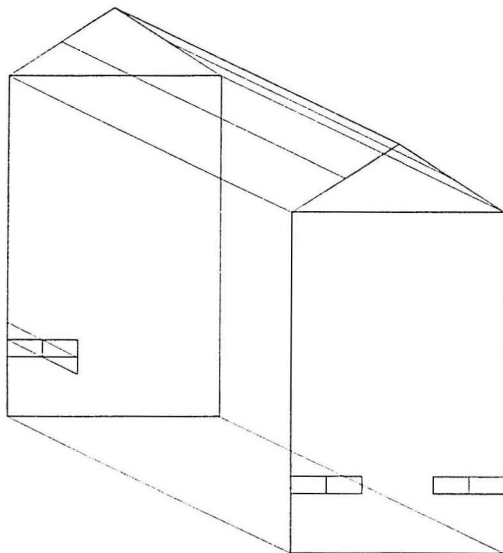

Outline of the atrium with openings


The monitoring programme consists of measurements of surface- and air temperatures for a six month period and detailed air flow measurements for two short-term periods during summer and winter conditions. The measurements are used as boundary conditions for CFD simulations, and for verification of the CFD models.

The programme FLOVENT has been used for the CFD analysis.

Building description

Sukkertoppen is an old sugar refinery in Copenhagen, which was redeveloped into a multi-media house in 1992. A new building was added south of the existing building, and the two buildings are coupled with a glazed atrium.

The purpose of the atrium is to reduce the space heating load of the buildings, and to improve the daylight conditions in the attached buildings. This atrium is used as circulation area and has no permanent occupation. The atrium is heated to 16-18°C during the winter season, and is naturally ventilated during summer season.

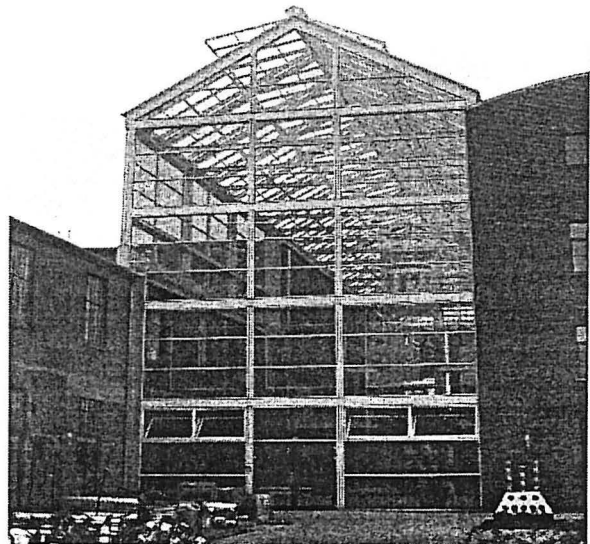

West end wall of the atrium Sukkertoppen.

The dimensions of the atria is 10 x 18.5 x 58 meter. The openings are placed in the end walls and at the top of the roof.

All glazed surfaces facing the outdoor air are low-energy glazing with an U-value of 1.6 W/m²K.

Indoor Climate




Summer

Natural ventilation with air supply through openings in end-walls, and outflow through the top of the roof. The airflow is characterized by moderate thermal stratification.

Ventilation rate: 46900 m³/h

Air change rate: 4.9 /h

Outdoor temperature: 20°C

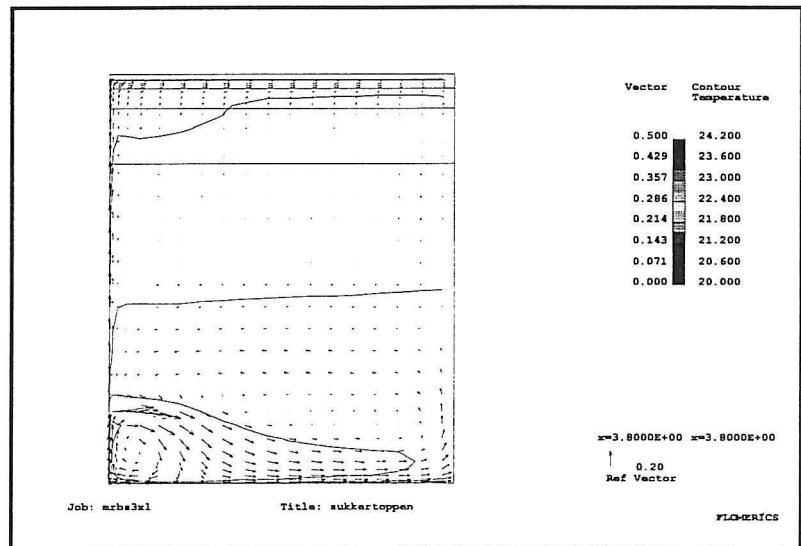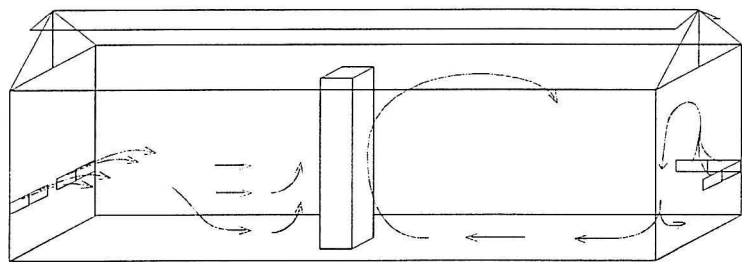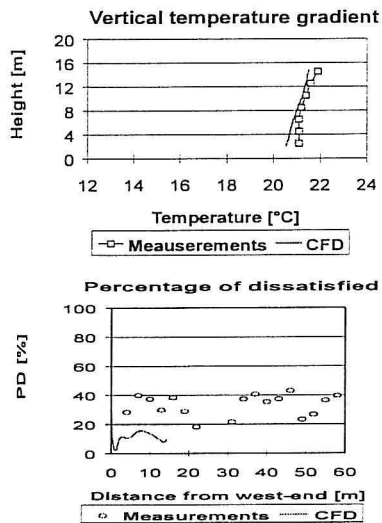




Winter

Infiltration through surfaces facing outdoor. The temperature measurements and a smoke test had shown mixed air, but the CFD model has a limited size, and lack of abilities to show the situation of mixed air due to infiltration.

Ventilation rate: 3350 m³/h


Air change rate: 0.35 /h

Outdoor temperature: 0°C

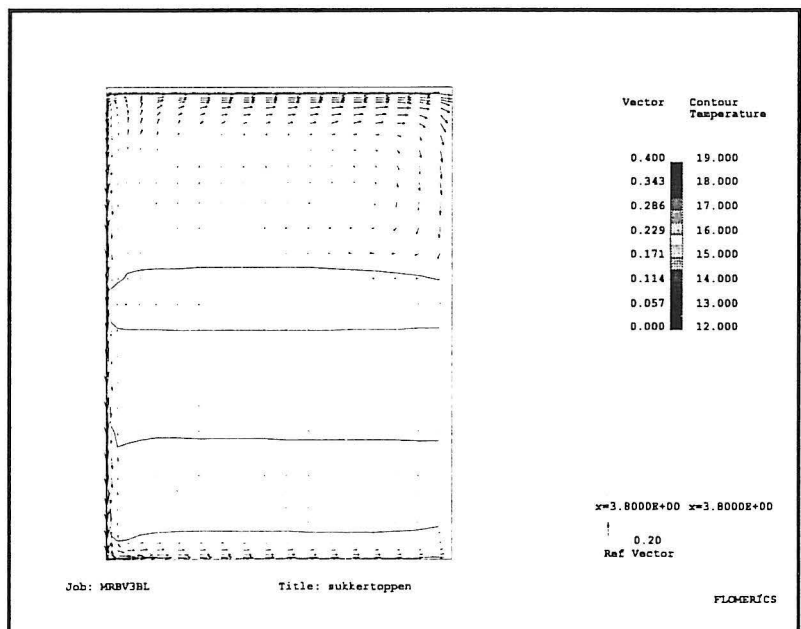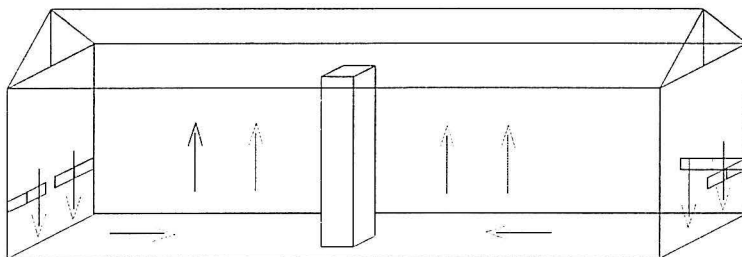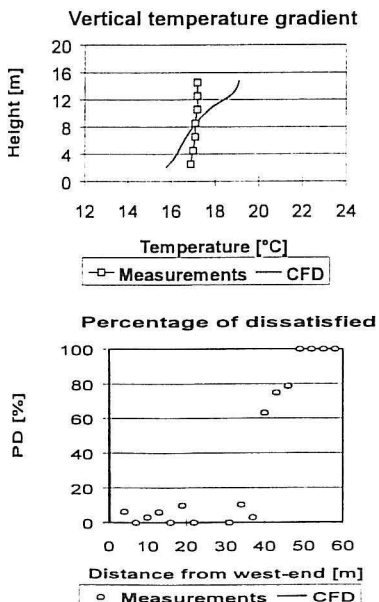


Natural ventilation

The capacity and the temperature conditions have been analyzed with CFD for three different configurations of natural ventilation at moderate summer conditions.




1. Openings in side walls

This configuration results in satisfying temperature conditions in the occupied zone, but leads to a high temperature gradient in the top of the atrium due to a pile of hot air.




2. Openings in top of the roof and the of the side walls

This configuration is characterized by the lowest ventilation rate and no temperature gradient, which indicates mixing of the air.




3. Openings in top of the roof and lower part of the side walls


This configuration has the largest distance between the openings, which results in the highest ventilation rate and the lowest temperatures.

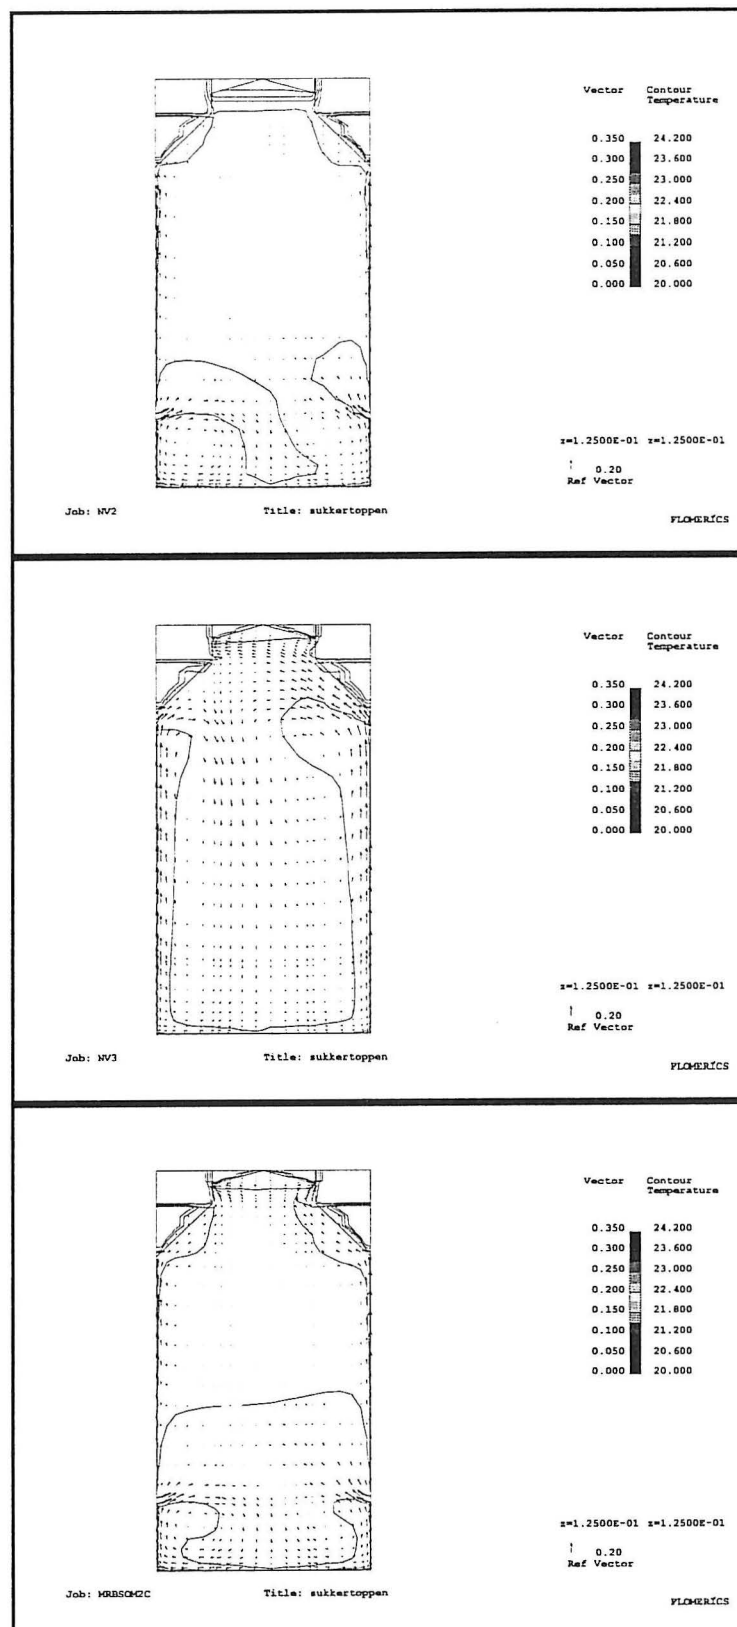

Capacity

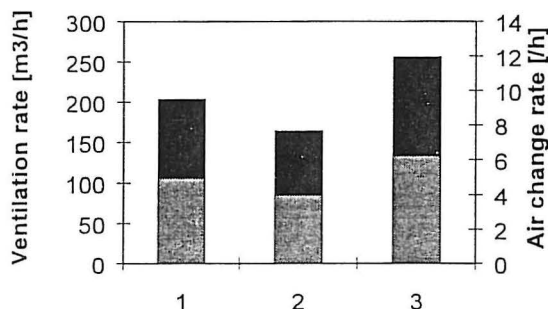

Vertical temperature gradient

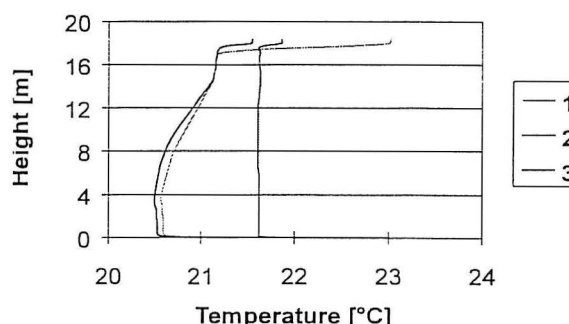

Daylighting

In order to improve the daylight conditions in the adjacent rooms at the lower floors, the window area has been increased. This increased window area was possible due to the use of low-energy glazing at the surfaces facing the outdoor, and without an increased heating load for the building.

Calculations have shown that the daylight factor is reduced at the front of the room and increased towards the back of room. This is very advantageous since both the daylight availability deep in the room is increased and the contrast ratio is reduced.

Conclusion

- CFD is a powerful tool to predict or evaluate ventilation and indoor climate of large glazed spaces.
- The boundary conditions for the CFD simulations should be treated carefully in order to obtain useful results.
- The analysis of the indoor climate for the naturally ventilated atrium has shown that it is possible to obtain a satisfying indoor climate during the summer period. In the winter period the PD index is rather high at the end walls due to cold draught, especially by the east end-wall due to wind pressure.

Integration of simulation tools

An important part of the CFD analysis is to estimate the boundary conditions, in order to obtain useful results for ventilation and air flow.

Dynamic thermal simulation programmes can be used to determine the surface temperatures and the energy balance for a room, and the results can be transferred to a CFD programme. Furthermore the air change rate calculated by CFD can be transferred back to the dynamic thermal simulation programme in order to improve the determination of the thermal performance and energy balance for the room.

Further information

Please contact:

Aalborg University

Kjeld Svindt

e-mail: i6ks@civil.auc.dk

Tel: +45 98 15 85 22

Fax: +45 98 14 82 43

Esbensen

Ole Juhl Hendriksen

e-mail: esbensen@inet.uni-c.dk

Esbensen Consulting Engineers FIDIC:

Teknikerbyen 38, DK-2830 Virum

Tel.: +45 45 83 42 24 Fax +45 45 83 68 34

Private Danish consulting engineering company with more than 30 years of experience in energy research, development and realization within:

- Energy efficient building design
- Advanced daylight and energy simulations
- Passive and active solar energy
- Photovoltaic systems

Esbensen is also participating in several national and international R&D projects in the fields of daylighting and utilization of solar energy.

PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 34: T. V. Jacobsen, P. V. Nielsen: *Numerical Modelling of Thermal Environment in a Displacement-Ventilated Room*. ISSN 0902-7513 R9337.

PAPER NO. 35: P. Heiselberg: *Draught Risk from Cold Vertical Surfaces*. ISSN 0902-7513 R9338.

PAPER NO. 36: P. V. Nielsen: *Model Experiments for the Determination of Airflow in Large Spaces*. ISSN 0902-7513 R9339.

PAPER NO. 37: K. Svidt: *Numerical Prediction of Buoyant Air Flow in Livestock Buildings*. ISSN 0902-7513 R9351.

PAPER NO. 38: K. Svidt: *Investigation of Inlet Boundary Conditions Numerical Prediction of Air Flow in Livestock Buildings*. ISSN 0902-7513 R9407.

PAPER NO. 39: C. E. Hyldgaard: *Humans as a Source of Heat and Air Pollution*. ISSN 0902-7513 R9414.

PAPER NO. 40: H. Brohus, P. V. Nielsen: *Contaminant Distribution around Persons in Rooms Ventilated by Displacement Ventilation*. ISSN 0902-7513 R9415.

PAPER NO. 41: P. V. Nielsen: *Air Distribution in Rooms - Research and Design Methods*. ISSN 0902-7513 R9416.

PAPER NO. 42: H. Overby: *Measurement and Calculation of Vertical Temperature Gradients in Rooms with Convective Flows*. ISSN 0902-7513 R9417.

PAPER NO. 43: H. Brohus, P. V. Nielsen: *Personal Exposure in a Ventilated Room with Concentration Gradients*. ISSN 0902-7513 R9424.

PAPER NO. 44: P. Heiselberg: *Interaction between Flow Elements in Large Enclosures*. ISSN 0902-7513 R9427.

PAPER NO. 45: P. V. Nielsen: *Prospects for Computational Fluid Dynamics in Room Air Contaminant Control*. ISSN 0902-7513 R9446.

PAPER NO. 46: P. Heiselberg, H. Overby, & E. Bjørn: *The Effect of Obstacles on the Boundary Layer Flow at a Vertical Surface*. ISSN 0902-7513 R9454.

PAPER NO. 47: U. Madsen, G. Aubertin, N. O. Breum, J. R. Fontaine & P. V. Nielsen: *Tracer Gas Technique versus a Control Box Method for Estimating Direct Capture Efficiency of Exhaust Systems*. ISSN 0902-7513 R9457.

PAPER NO. 48: Peter V. Nielsen: *Vertical Temperature Distribution in a Room with Displacement Ventilation*. ISSN 0902-7513 R9509.

PAPER NO. 49: Kjeld Svidt & Per Heiselberg: *CFD Calculations of the Air Flow along a Cold Vertical Wall with an Obstacle*. ISSN 0902-7513 R9510.

PAPER NO. 50: Gunnar P. Jensen & Peter V. Nielsen: *Transfer of Emission Test Data from Small Scale to Full Scale*. ISSN 1395-7953 R9537.

PAPER NO. 51: Peter V. Nielsen: *Healthy Buildings and Air Distribution in Rooms*. ISSN 1395-7953 R9538.

PAPERS ON INDOOR ENVIRONMENTAL TECHNOLOGY

PAPER NO. 52: Lars Davidson & Peter V. Nielsen: *Calculation of the Two-Dimensional Airflow in Facial Regions and Nasal Cavity using an Unstructured Finite Volume Solver*. ISSN 1395-7953 R9539.

PAPER NO. 53: Henrik Brohus & Peter V. Nielsen: *Personal Exposure to Contaminant Sources in a Uniform Velocity Field*. ISSN 1395-7953 R9540.

PAPER NO. 54: Erik Bjørn & Peter V. Nielsen: *Merging Thermal Plumes in the Indoor Environment*. ISSN 1395-7953 R9541.

PAPER NO. 55: K. Svidt, P. Heiselberg & O. J. Hendriksen: *Natural Ventilation in Atria - A Case Study*. ISSN 1395-7953 R9647.

PAPER NO. 56: K. Svidt & B. Bjerg: *Computer Prediction of Air Quality in Livestock Buildings*. ISSN 1395-7953 R9648.

PAPER NO. 57: J. R. Nielsen, P. V. Nielsen & K. Svidt: *Obstacles in the Occupied Zone of a Room with Mixing Ventilation*. ISSN 1395-7953 R9649.

PAPER NO. 58: C. Topp & P. Heiselberg: *Obstacles, an Energy-Efficient Method to Reduce Downdraught from Large Glazed Surfaces*. ISSN 1395-7953 R9650.

PAPER NO. 59: L. Davidson & P. V. Nielsen: *Large Eddy Simulations of the Flow in a Three-Dimensional Ventilated Room*. ISSN 1395-7953 R9651.

PAPER NO. 60: H. Brohus & P. V. Nielsen: *CFD Models of Persons Evaluated by Full-Scale Wind Channel Experiments*. ISSN 1395-7953 R9652.

PAPER NO. 61: H. Brohus, H. N. Knudsen, P. V. Nielsen, G. Clausen & P. O. Fanger: *Perceived Air Quality in a Displacement Ventilated Room*. ISSN 1395-7953 R9653.

PAPER NO. 62: P. Heiselberg, H. Overby & E. Bjørn: *Energy-Efficient Measures to Avoid Downdraft from Large Glazed Facades*. ISSN 1395-7953 R9654.

PAPER NO. 63: O. J. Hendriksen, C. E. Madsen, P. Heiselberg & K. Svidt: *Indoor Climate of Large Glazed Spaces*. ISSN 1395-7953 R9655.

PAPER NO. 64: P. Heiselberg: *Analysis and Prediction Techniques*. ISSN 1395-7953 R9656.

PAPER NO. 65: P. Heiselberg & P. V. Nielsen: *Flow Element Models*. ISSN 1395-7953 R9657.

PAPER NO. 66: Erik Bjørn & P. V. Nielsen: *Exposure due to Interacting Air Flows between Two Persons*. ISSN 1395-7953 R9658.

PAPER NO. 67: P. V. Nielsen: *Temperature Distribution in a Displacement Ventilated Room*. ISSN 1395-7953 R9659.

PAPER NO. 68: G. Zhang, J. C. Bennetsen, B. Bjerg & K. Svidt: *Analysis of Air Movement Measured in a Ventilated Enclosure*. ISSN 139995-7953 R9660.

Department of Building Technology and Structural Engineering
Aalborg University, Sohngaardsholmsvej 57. DK 9000 Aalborg
Telephone: +45 9635 8080 Telefax: +45 9814 8243